




Installation Location Guide

DAIKIN UK.PA604


Notes

1. Where the UK.PA604 is shown in red, this indicates its recommended position within the fan coil unit.
2. The image in the blue circle shows a blow-up of the UK.PA604 installed within the fan coil unit without the grille or filter fitted.


1 Way blow corner cassette

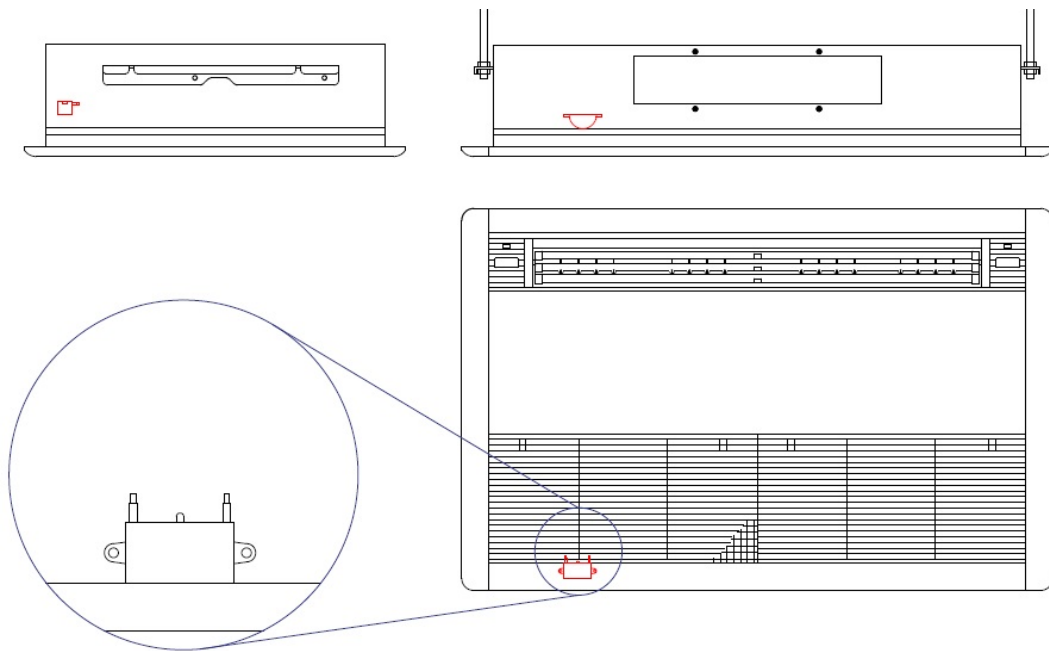


2-way blow cassette

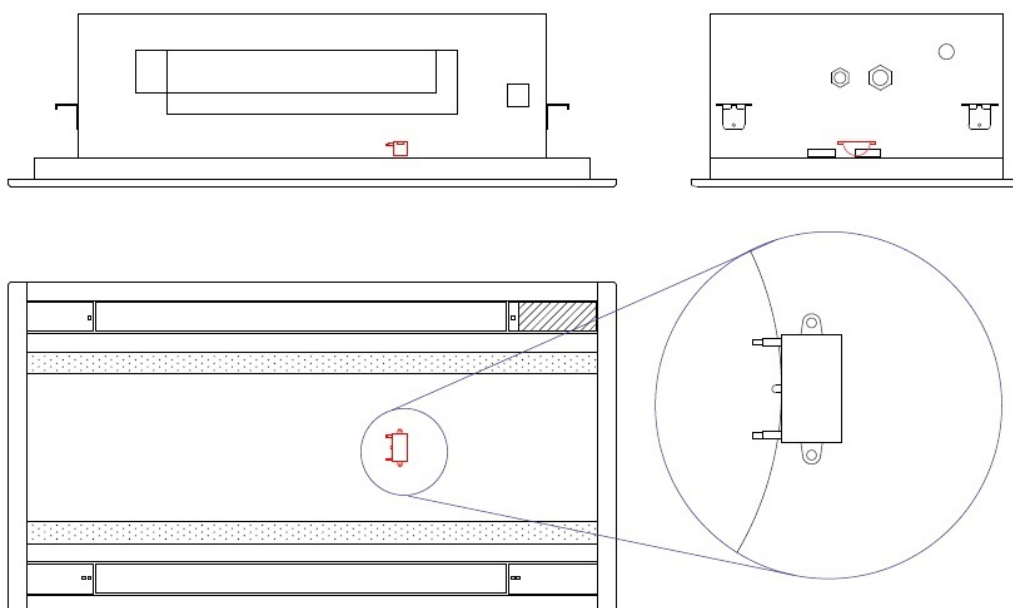


Ceiling suspended cassette

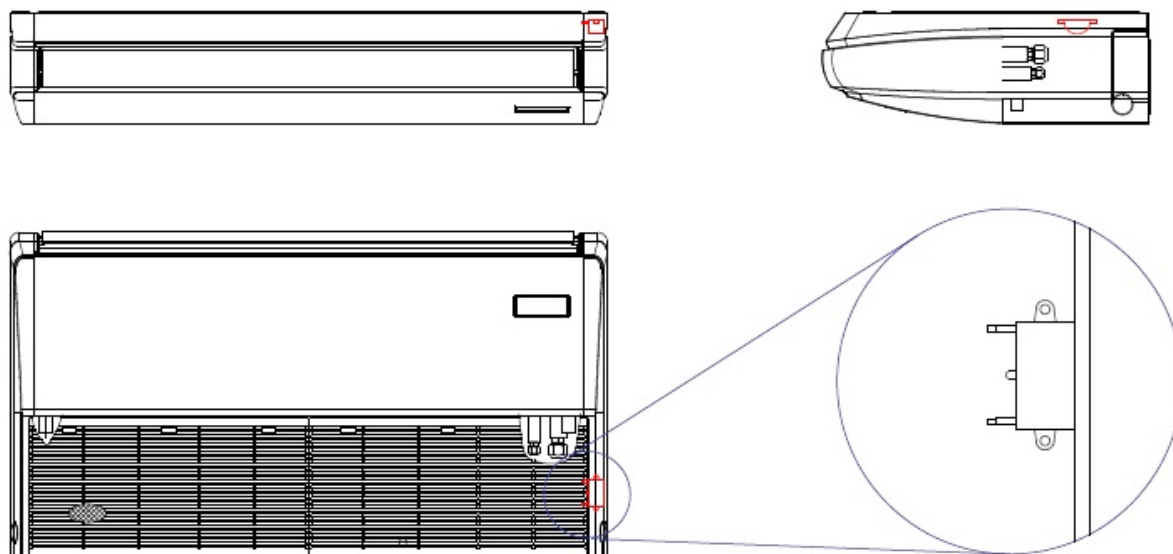


Ducted unit

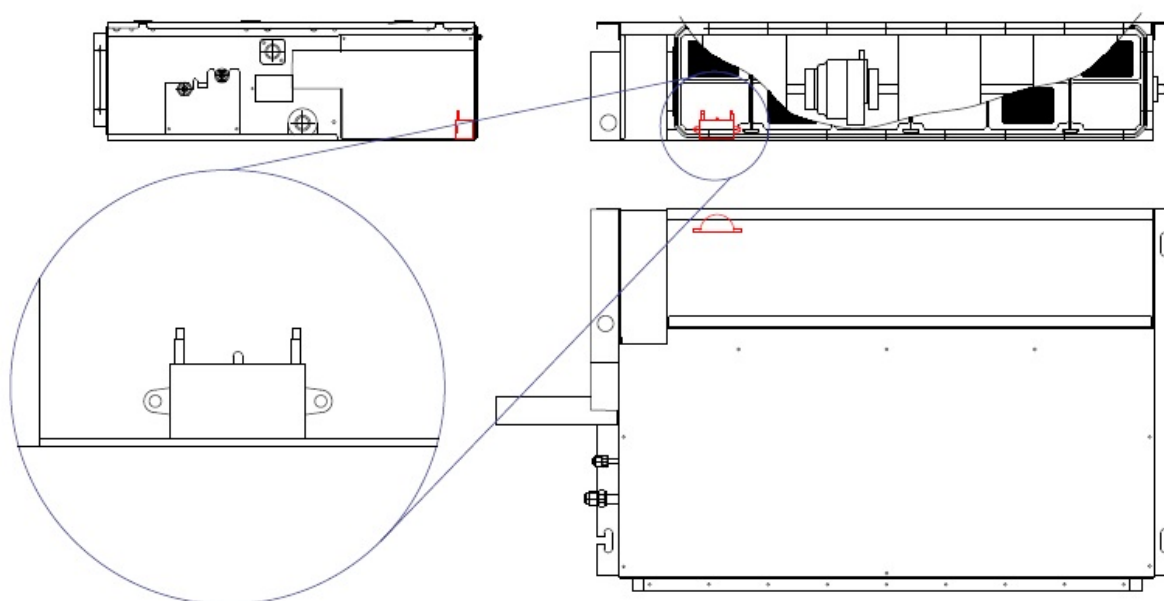

Floor standing unit

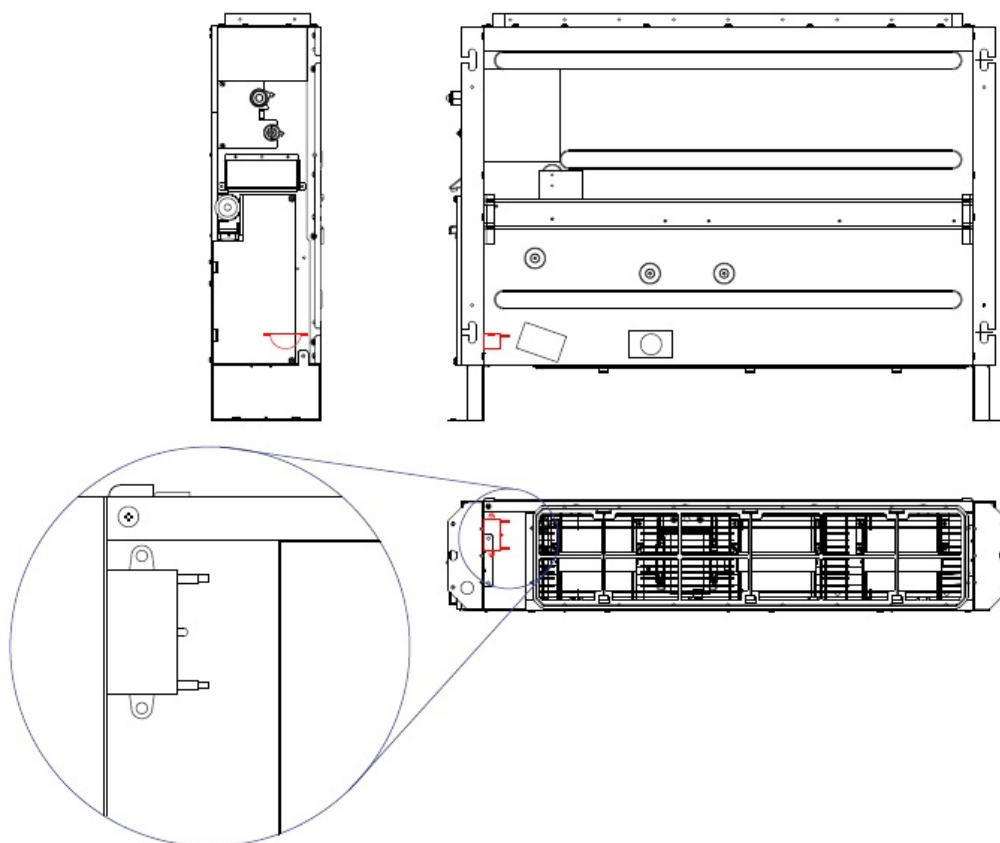

Fully Flat Cassette

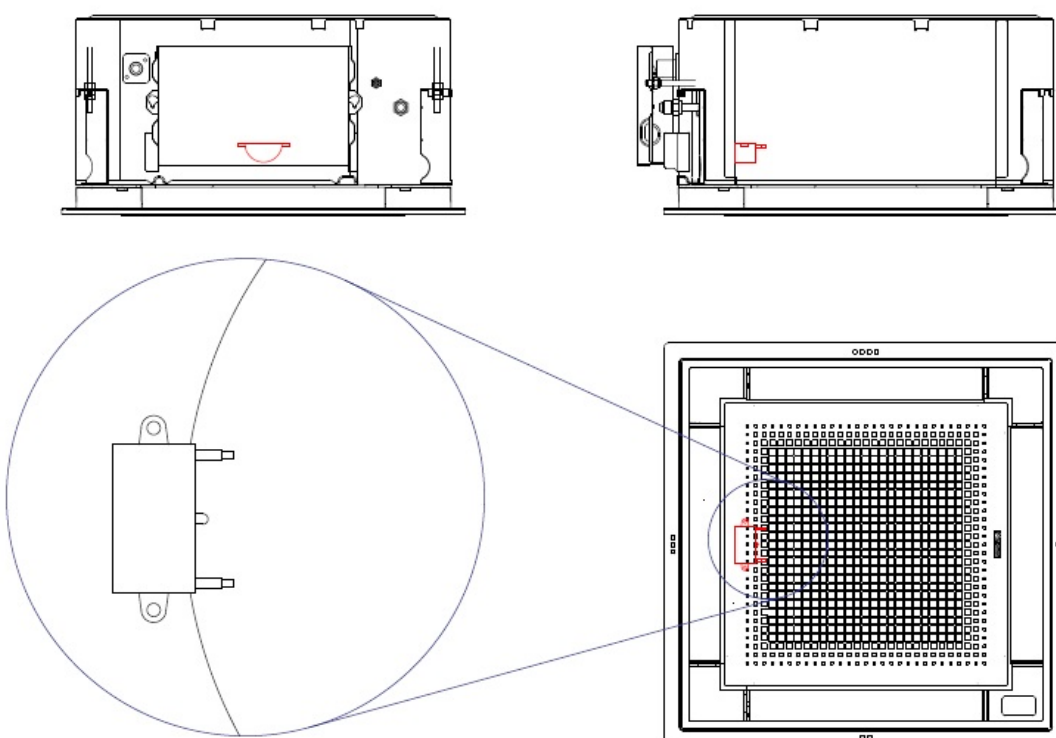

Roundflow cassette

